




300LD3RL3NB CAT 4

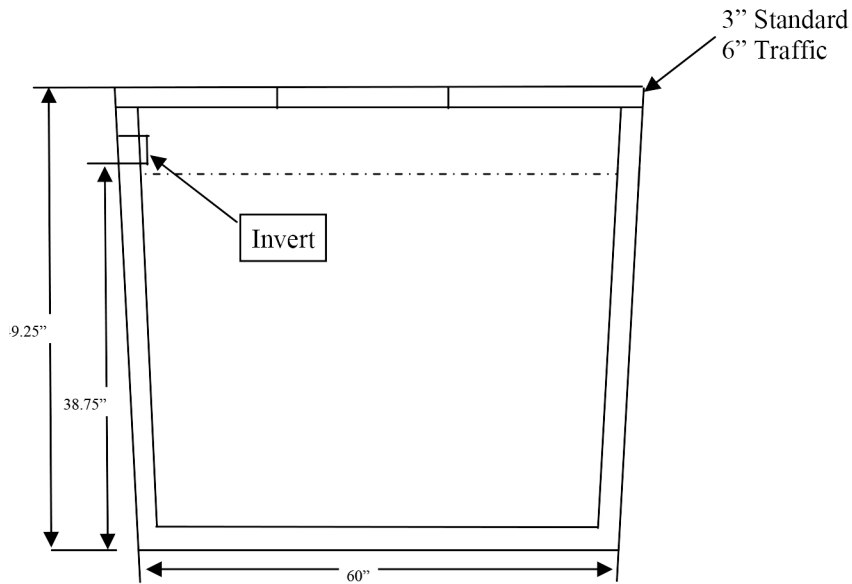

Side View

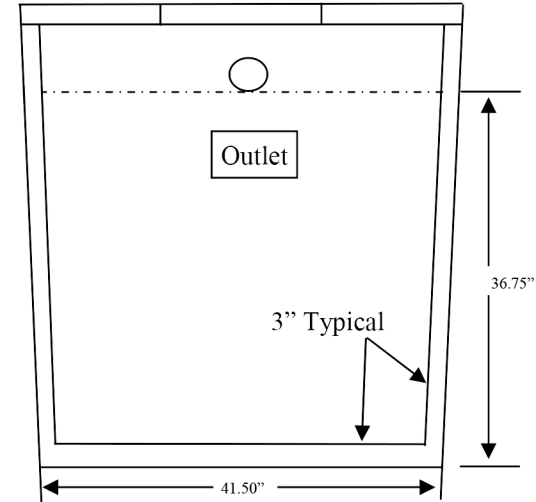

End View

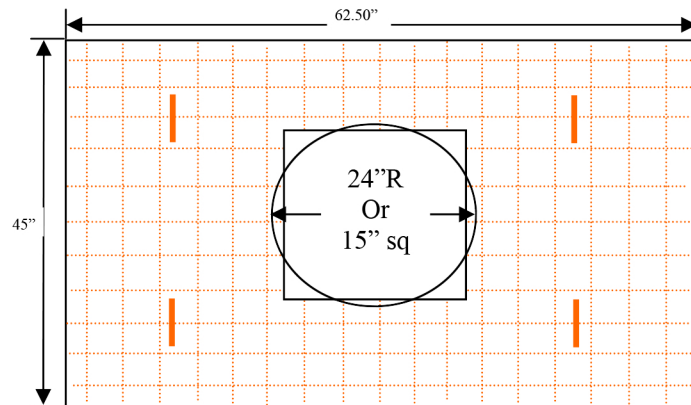

Lid View

Notes:

Receptacle has been designed and tested in accordance with Florida Administrative Code (FAC) 381 Chapter 64E-6.

When receptacle is used as a pump chamber use 8.62 gallons per inch when configuring float placement.

Poly II High Pressure Pipe Seal (Accepts 2", 3", 4" & Corrugated Pipe) Poly II will meet the Vacuum & Hydrostatic pressure requirements of A.S.T.M. spec. C-923 for 2", 3" & 4" SCHD.40

